

Please read this document carefully before using this product. The guarantee will be invalidated if the device is damaged by not following instructions detailed in the manual. The company shall not be responsible for any damage or losses however caused, which may be experienced as a result of the installation or use of this product.

ENDA EDT5412 TEMPERATURE CONTROLLER

Thank you for choosing ENDA EDT5412 temperature controller.



R_®HS Compliant



*56x94mm sized.

- *On-Off control.
- *Relay output for cooling or heating control.
- *Relay output for defrosting or lighting
- *Single NTC probe input.
- *Offset value can be entered for NTC probe.
- *Compressor protection parameters can be entered.
- *In the case of probe failure,output state can be selected as on, off or periodical running.
- *Upper and lower limits of the setpoint can be adjusted.
- *Defrosting duration and interval can be adjusted.
- *6 different warning tones.
- *Upper and lower limits of the alarm value can be adjusted depending on the setpoint value.
- *Temperature unit can be selected as °C or °F.
- *External alarm can be given by using digital input.
- *Defrosting or lighting(configurable) can be started by using digital input.
- *Manually defrosting or lighting(configurable) feature.

 *Parameter can be transferred by using "ENDAKEY" without
- *Parameter can be transferred by using "ENDAKEY" without connecting the device to mains supply.
- *Communication feature over RS485 ModBus protocol(optional). *With Real Time Clock, energy-saving and defrosting feature and
- configurable lighting feature(optional).
 *CE marked according to European Norms.

1 - Supply Voltage

230......230V AC 2424V AC/DC

1212V AC/DC SM9-30V DC/7-24V AC

2-Output

R...... 8A relay output P...... 20A relay output

3- RTC

Real time clock (optional)
(Only valid for 8A relay output devices)

4-ModBus

RS......ModBus (optional)



ENDA EDT5412 is a rail mounted device. Make sure that the device is used only for intended purpose. The electrical connections must be carried out by a qualified staff and must be according to the relevant locally applicable regulations. During an installation, all of the cables that are connected to the device must be free of electrical power. The device must be protected against inadmissible humidity, vibrations, severe soiling and make sure that the operation temperature is not exceeded. The cables should not be close to the power cables or components.

CONNECTION DIAGRAM









NOTE: SUPPLY:	Fuse F 100 mA 250V AC Switch
184-253V AC	10 ← Line ← 230V AC
50/60Hz 4VA	11 Neutral Supply
	Fuse should
	be connected Cable size: 1,5mm²


Note:

- 1) Mains supply cords shall meet the requirements of IEC 60227 or IEC 60245.
- In accordance with the safety regulations, the power supply switch shall bring the identification of the relevant instrument and it should be easily accessible by the operator.

ENVIRONMENTAL CO	ONDITIONS
Ambient/storage temperat	ure 0 +50°C/-25 70°C (without icing)
Relative humidity	%80,up to 31°C decreasing linearly %50 at 40°C.
Protection class	According to En60529; Front panel: IP65 Rear panel: IP20
Height	Max. 2000m
Do not use the de	vice in locations subject to corrosive and flammable gasses.
ELECTRICAL CHAR	ACTERISTICS
Supply voltage	230V AC +%10 -%20, 50/60Hz or 12/24 V AC/DC ± %10
Power consumption	Max. 5VA
Connection	2.5mm² screw-terminal connections
Scale	-60.0 +150.0°C (-76.0 +302.0°F)
Sensitivity	0.1°C (Can be chosen as 0.1°C or 1°C.)
Accuracy	±1°C
Time accuracy	±%1
Display	4 digits, 12.5mm, 7 segment LED
EMC	EN 61326-1: 2006
Safety requirements	EN 61010-1: 2012 (Pollution degree 2, overvoltage category II)
OUTPUTS	
Compressor relay	For EDT5412-X-R; Relay:NO+NC 250V AC,8A (for resistive load),1/2hp 240V AC (for inductive load)
output	For EDT5412-X-P; Relay:NO 277V AC,20A (for resistive load),2hp 250V AC (for inductive load)
Defrosting and lighting relay output	For EDT5412-X-R; Relay:NO+NC 250V AC,8A (for resistive load), 1/2hp 240V AC (for inductive load)
Life expectancy for compressor relay output	For EDT5412-X-R; Without load 30.000.000 switching; 250V AC, 8A (resistive load) 100.000 switching. For EDT5412-X-P; Without load 10.000.000 switching; 277V AC, 20A (resistive load) 100.000 switching.
Life expectancy for defrosting and lighting relay output	For EDT2412-X-R; Without load 30.000.000 switching; 250V AC, 8A (resistive load) 100.000 switching.
CONTROL	
Control type	Single set-point control
Control algorithm	On-Off control
Hysteresis	Adjustable between 1 20.0°C.
HOUSING	
Housing type	Mounted to TH35 type rail that is in accordance with EN60715 standarts
Dimensions	W56xH94xD58mm
Weight	Approx. 190g (After packing)



While cleaning the device, solvents (thinner, benzine, acid etc.) or corrosive materials must not be used.

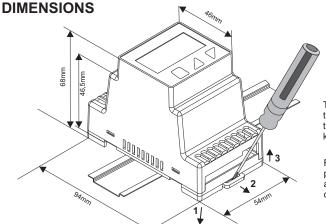


Self extinguishing plastics.

The device to be mounted on rail; the device in direction 1 to push the rails,the rails provide the key to keeping the rail.

For removing the device from rail; push the rail lock in direction **2** with a screwdriver and pull the device in direction **3**.


SİSEL MÜHENDİSLİK ELEKTRONİK SAN. VE TİC. A.Ş. Yukarı Dudullu Barbaros Cad. Kutup Sok. No:20 34775 - ÜMRANİYE/İSTANBUL/TÜRKİYE Tel : +90 216 499 46 64 Pbx. Fax : +90 216 365 74 01

url: www.enda.com.tr

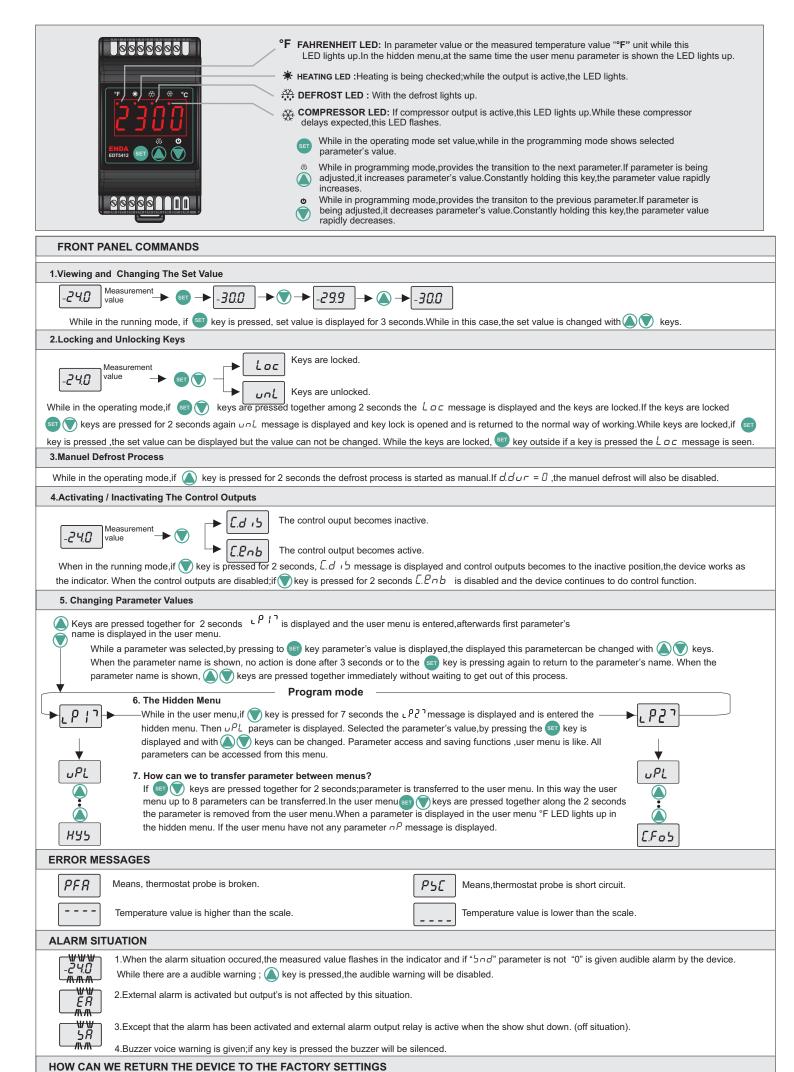

Key is held down while the device is powered up the d.PRr message will see and restore the factory parameters.

OUTPUT GRAPHICS d.dPo (Ifd.Pon = 5 d.dPo timer runs.)d. in E ddu Defrost LED HEAT LED НΕ HEAT OUTPUT (heating) contro COMPRESSOR LED COMPRESSOR Pon Aupl-Aupl Rupl-Auss SET+ c.HSS SET- c.HSS RLoL+AUSS Alol RdPo RJFL Temperature alarm Digital input dd i dgital input delay External alarm situation

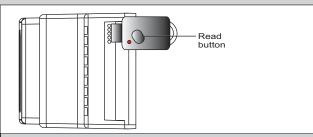

How Can We Dowload The Parameters From ENDAKEY To The Device?

While in the running mode;if vey or "Read" button (in ENDAKEY) are pressed; is displayed "dL" message and parameters are read in ENDAKEY.

"dL" message appears when the 🔘 key is pressed again,reading parameter values from the ENDAKEY are transferred to the device.

If the parameter transfer is successful," $\vdash\! EF$ "message is displayed and the

device begins to work with dowloaded parameters value. The parameter in the ENDAKEY,while belonging to a different device of if there is a malfunction in the ENDAKEY "£ r r" message is displayed and the parameters of the device unchanged.

How Can We Upload The Parameters From Device To The ENDAKEY?

While in the running mode; if (a) key is pressed "u L" message is displayed and again (a) key is pressed; if there is no error ,the parameters in the device are loaded in to the ENDAKEY and "buc" message is displayed.

If there is a malfunction in the device and the installation failed " $\mathcal{E} \Gamma \Gamma$ " message

NOTE 1:To the device without energy,the parameter transfer is done with **FNDAKFY**

The battery inside the ENDAKEY for a longer period of time; after the parameter transfer process, the connection between the ENDAKEY and the device should be disconnected.

NOTE 2:ENDAKEY device, is supplied with orders if requested.

	TROL PARAMETERS	MIN.	MAX.	UNIT	DEF. SET
ی۹۲ ا	The upper limit of the setpoint	- 60.0		°C	<u> 150 </u>
LoL	The lower limit of the setpoint	LoL	150.0	°C	- 60
H32	Switch hysteresis for compressor (hysteresis)	D. 1	20.0	°C	2
oFF	The offset value for the refrigeration	- 20.0	20.0	°C	0
	FIGURATION PARAMETERS				
C.E YP	Control type selection(HE =(*) heating control is selected, E = Cooling control is selected.) E = E = Cooling control is selected.)	Cο	HE		٥٦
C.out	Defrosting(lighting) relay output type selection.(dEF = relay is used for defrosting. $LGhE$ = relay is used for lighting)	dEF	LűhE		dЕF
Un it	Temperature unit	°C	°F		°C
dPnŁ	Decimal point (na = decimal point isn't shown 22°C, 45 5 = decimal point is shown 22.3°C.)	no	<i>YE</i> 5		no
Snd	Type of buzzer sound (6 different voice types can be selected.Alarm during II is chosen,the voice warning is canceled.)For Relay-8A is valid.	0	6		0
d. inP	Digital input types. αd :Digital input unused. $\mathcal{E}R$:External alarm. $\mathcal{E}R$ message flashes in the display.Output unchanged. $\mathcal{E}R$: Important external alarm. $\mathcal{E}R$ message flashes in the display.Relay output is turned off. $\mathcal{H}\mathcal{E}$: Control type. $\mathcal{E}\mathcal{E}\mathcal{P}$ parameter is changed.(If $\mathcal{H}\mathcal{E} = \mathcal{E}\alpha$, If $\mathcal{E}\alpha = \mathcal{H}\mathcal{E}$) \mathcal{F} :Defrost operation is started.	nd	dF		nd
dd ,	Digital input delay. The period of the digital inputs to be active.	0:00	99:00		0:00
дΡο	Digital input polarity. c L = While a digital input contact is closed,it is activated. • P = While a digital input is opened, it is activated.	ΣL	o٩		ΕL
COMI	PRESSOR PROTECTION PARAMETERS				
[.Pon	Delay time for the compressor after power is on.	0:00	99:00	min:sec	1:00
C.Fo5	Delay time required for the compressor to restart following a stop.	0:00	99:00	min:sec	1:00
C.PPn	On time for the compressor output in the case of probe failure.	0:00	99:00	min:sec	0:00
C.PPF	Off time for the compressor output in the case of probe failure. Off time for the compressor output in the case of probe failure	0:00	99:00	min:sec	1:00
	OST CONTROL PARAMETERS	0.00	33.00	111111.300	7.00
dE YP	Defrosting type selection.(£L £= electrical defrosting. £85= Hot gas (reverse output) defrosting)	ELC	GR5		ELC
d.dur	Defrost duration (If $d.dur = 0$, automatic and manual defrost are disabled.)	0:00	99:00	min:sec	1:00
d. int	The time between 2 consecutive defrosts.	1:00	99:00		1:00
0. 1112	During defrost, display configuration ($r \mathcal{E}$ = Real temperature is displayed during defrost).	1:00	טט:עע	nr:min	7:00
d.d5P	(L c = The temperature which is measured before defrost is displayed during defrost).	Lc.	ΓΕ		Lc.
d.drE	Delay time for display real temperature after defrost is over.	0:00	99:00	min:sec	1:00
d.Pon	Defrosting process begins with energy (na=Defrost process doesn't start when,the energy comes. 9E5=Defrost process starts when the energy comes.)	no	<i>4</i> £5		no
d.dPo	Delay time for defrosting after power is on.	0:00	99:00	min:sec	1:00
d.drb	Delay time for defrosting after power is on. Dripping (discharge) time	0:00 0:00	99:00 99:00	min:sec min:sec	2:00
d.drt					
d.drt	Dripping (discharge) time	0:00		min:sec	
d.drt ALAR	Dripping (discharge) time M CONTROL PARAMETERS		99:00	min:sec	2:00 150
d.drt ALAR R.uPL	Dripping (discharge) time M CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted.	0:00 A.L.a.L -60.0	99:00 150.0 R.JPL	min:sec	2:00
ddrt ALAR RuPL RLoL RHYS	Dripping (discharge) time M CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLaL should be readjusted.	0:00 R.L.o.L -60.0 0.1	99:00 1500 RuPL 200	°C	2:00 150 -60
ddrt ALAR RuPL RLoL	Dripping (discharge) time M CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLoL should be readjusted. Switch hysteresis for alarm. Alarm configuration. (Rb5=Absolute alarm.Alarm values are RLoL and RuPL.) (rEF= Relative alarm.Alarm values are SET-RLoL and SET+RuPL.) NOTE: Upper and Lower alarm level variables are determined according to the "REYP" parameter.	0:00 A.L.a.L -60.0	99:00 150.0 R.JPL	°C	2:00 150 -60 2
d.drt ALAR R.JPL R.L o.L R.HYS R.EYP	Dripping (discharge) time IM CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLoL should be readjusted. Switch hysteresis for alarm. Alarm configuration. (Rb5=Absolute alarm.Alarm values are RLoL and RuPL.) (rEF= Relative alarm.Alarm values are SET-RLoL and SET+RuPL.) NOTE: Upper and Lower alarm level variables are determined according to the "REYP" parameter. If REYP=Rb5, RLoL and RuPL. If REYP=rEF,LoL=SET-RLoL and RuPL.	0:00 AL oL -600 O. I R65	99:00 150:0 8.uPL 20:0 r EF	°C °C °C	2:00 150 -60 2 AbS
ALAR RUPL RLOL RHYS REYP RAGEL	Dripping (discharge) time IM CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLoL should be readjusted. Switch hysteresis for alarm. Alarm configuration. (Rb5=Absolute alarm.Alarm values are RLoL and RuPL.) (rEF= Relative alarm.Alarm values are SET-RLoL and SET+RuPL.) NOTE: Upper and Lower alarm level variables are determined according to the "REYP" parameter. If REYP=RB5, RLoL and RuPL. If REYP=rEF,LoL=SET-RLoL and RuPL. Time delay to display alarm message after alarm is on.	0:00 AL aL -600 0.1 Abs	99:00 150.0 8.uPL 20.0 rEF	°C	2:00 150 -60 2 Ab5
ALAR RUPL RLOL RHYS REYP RAFL RAPO	Dripping (discharge) time IM CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLoL should be readjusted. Switch hysteresis for alarm. Alarm configuration. (Rb5=Absolute alarm.Alarm values are RLoL and RuPL.) (rEF= Relative alarm.Alarm values are SET-RLoL and SET+RuPL.) NOTE: Upper and Lower alarm level variables are determined according to the "REYP" parameter. If REYP=Rb5, RLoL and RuPL. If REYP=rEF,LoL=SET-RLoL and RuPL.	0:00 AL oL -600 O. I R65	99:00 150:0 8.0PL 20:0 c EF 99:00 24:00	°C °C °C	150 -60 2 Ab5
ALAR RUPL RLOL RHYS REYP RAGEL	Dripping (discharge) time IM CONTROL PARAMETERS Limit for upper alarm level. When REYP is changed, RuPL should be readjusted. Limit for lower alarm level. When REYP is changed, RLoL should be readjusted. Switch hysteresis for alarm. Alarm configuration. (Rb5=Absolute alarm.Alarm values are RLoL and RuPL.) (rEF= Relative alarm.Alarm values are SET-RLoL and SET+RuPL.) NOTE: Upper and Lower alarm level variables are determined according to the "REYP" parameter. If REYP=RB5, RLoL and RuPL. If REYP=rEF,LoL=SET-RLoL and RuPL. Time delay to display alarm message after alarm is on.	0:00 AL aL -600 0.1 Abs	99:00 150.0 8.uPL 20.0 rEF	°C °C °C	2:00 150 -60 2 Ab5

		Min.	Max.	Unit	Status
_	The device time setting	0	23	hour	0
	The device minute setting	0	59	minute	0
	The device day setting 5 un, non, EuP, UPd, Ehu, Fr 1,5 RE	ممح	SAE	day	200
	The first day of the week holiday. $5un,\bar{n}on, EuE, UEd, Ehu, Fri,$ $5RE, nu$. (If nu is chosen, holidays are not selected and it is perceived as working days.)	Տսո	nυ	day	ПШ
	The second day of the week holiday. ($5un,\bar{n}on, EuE, UEd, Ehu, Fri, 5RE, nu$. (If nu is chosen, holiday are not selected and it is perceived as working days.)	سم	CΩ	day	ſυ
R	OST CONTROL PARAMETERS				
IP	The device defrost type. (nor :with interval times defrost, $r \not\models c$:with real time clock defrost)	пог	rtc	-	пог
/	## I, rd2, rd3, rd4, rd5, rd6 Defrost status time in the range of ## I- rd6 workdays.(If this status time=24:00,defrost process is not performed.	00:00	24:00	hr:min	24:01
<i>d</i> 5	EdI,EdZ,EdJ,EdJ,EdJ,EdG. Defrost status time in the range of $EdI-EdG$ holidays. (If this status time= 24:00 defrost process is not performed.)	00:00	24:00	hr:min	24:0
R	GY-SAVING PARAMETERS				
	Energy-saving value of the difference set (During the energy-saving SET=SET+#dd. Energy-saving during ,the set value does not change.	-20	20	°C/°F	0
	Energy-saving start time of the workday.(If this status time=24:00 energy-saving will not be made.)	00:00	24:00	hr:min	24:0
	Workday energy-saving time(If this status time= $\Box\Box:\Box\Box$ energy-saving will not be made.)	00:00	24:00	hr:min	24:0
:	Energy-saving start time of the holiday.(If this status time $24:00$ energy-saving will not be made.)	00:00	24:00	hr:min	24:0
,	Holiday energy-saving time(If this status time: $\Box\Box:\Box\Box$ energy-saving will not be made.)	00:00	24:00	hr:min	24:0
\L	TIME CLOCK FEATURE				
ned ose ay. V	power up of the device;hour,minute,day must be adjusted.In addition,and to the desired days.All the days of the week "workday" is entered as requent as "nu". This sets the device is powered down, even after the 2500 real to with this feature, defrost control and energy-saving can be requested.	ested, <i>hE</i>	l and he	paramet	ters sho
HT	ING PARAMETERS		I		
Ŀ	Weekday lighting start time	00:00	24:00	hr:min	24:0
4	Weekday lighting finish time	00:00	24:00	hr:min	24:0
Ł	Weekend lighting start time	00:00	24:00	hr:min	24:01
8	Weekend lighting finish time	00:00	24:00	hr:min	24:01

4/6

bRUd Baudrate (0=Off;1=1200;2=2400; 3=4800; 4=9600; 5=19200)

EDT5412-E-01-R-201307

19.20

oFF

9600

Holding	Register					
Add	resses	Data Type	Data Content	Parameter Name	Read/Write Permission	Status Value
Decimal	Hex	Type		Name	T GTTTTGGTGTT	Value
0000d	0x0000	word	Set value		Readable/Writeable	-20
0001d	0x0001	word	Set point upper limit	υPL	Readable/Writeable	150
0002d	0x0002	word	Set point lower limit	LoL	Readable/Writeable	-60
0003d	0x0003	word	Cooling hysteresis	H95	Readable/Writeable	2
0004d	0x0004	word	Offset value for the cooling	oFF	Readable/Writeable	0
0005d	0x0005	word	Type of buzzer sound	5nd	Readable/Writeable	0
0006d	0x0006	word	Digital input types .0=nd;1=ER;2=5R;3=HC;4=dF	d. inP	Readable/Writeable	nd
0007d	0x0007	word	Digital input delay	dd ,	Readable/Writeable	0:00(0 s
0008d	0x0008	word	Delay time for the compressor after power is on.	C.Pon	Readable/Writeable	1:00(60 s
0009d	0x0009	word	Delay time required for the compressor to restart following a stop.	C.F o 5	Readable/Writeable	0:00(0 se
0010d	0x000A	word	On time for the compressor output in the case of probe failure	C.PPn	Readable/Writeable	0:00(0 se
0011d	0x000B	word	Off time for the compressor output in the case of probe failure	C.PPF	Readable/Writeable	1:00(60 s
0012d	0x000C	word	Defrost duration	d.dur	Readable/Writeable	1:00(60 s
0013d	0x000D	word	The time between 2 consecutive defrosts.	d. in E	Readable/Writeable	1:00(60 n
0014d	0x000E	word	Delay time for displaying the real temperature after completion of defrosting	d.dr E	Readable/Writeable	1:00(60 s
0015d	0x000F	word	Delay time for defrosting after power is on.	d.dPo	Readable/Writeable	1:00(60 s
0016d	0x0010	word	Dripping (discharge) time	d.dr E	Readable/Writeable	2:00(120
0017d	0x0011	word	Upper level alarm	R.uPL	Readable/Writeable	150
0018d	0x0012	word	Lower level alarm	A.L o L	Readable/Writeable	-60
0019d	0x0013	word	Switch hysteresis for alarm	R.H.Y.5	Readable/Writeable	2
0020d	0x0014	word	Time delay to display alarm message after alarm is on.	A.dFL	Readable/Writeable	0:00(0 s
0021d	0x0015	word	Time delay to display alarm message after power is on.	A.dPo	Readable/Writeable	0:10(10 n
0022d	0x0016	word	RS485 Network address for the connection of the device. Adjutable between 1-247.	Adrb	Readable/Writeable	1
0023d	0x0017	word	Baudrate (0=Off; 1=1200; 2=2400; 3=4800; 4=9600; 5=19200)	bRud	Readable/Writeable	9600
0024d	0x0018	word	The device time setting	hour	Readable/Writeable	0
0025d	0x0019	word	The device minute setting	_ IU	Readable/Writeable	0
0026d	0x001A	word	The device day setting (১০০,៱০০,৮০৪,৪৪৪,৮৮০,৮৮ ,১৪৮)	48Y	Readable/Writeable	س <i>ا</i> 0)
0027d	0x001B	word	The first day of the week holiday	hE I	Readable/Writeable	7(กม
			(Sun, non, UEd, thu, Fr 1,58t, nu)			7,
0028d	0x001C	word	The second day of the week holiday (كسم, Ā̄oa, NBd, Ehu, F̄c 1, SBE, nu)	hŁ2	Readable/Writeable	7(กม
0029d	0x001D	word	Defrost start time of the 1. workday	ıd l	Readable/Writeable	24:00(hr:ı
0030d	0x001E	word	Defrost start time of the 2 workday	195	Readable/Writeable	24:00(hr:ı
0031d	0x001F	word	Defrost start time of the 3. workday	,d3	Readable/Writeable	24:00(hr:ı
0032d	0x0020	word	Defrost start time of the 4. workday	, 44	Readable/Writeable	24:00(hr:ı
0033d	0x0021	word	Defrost start time of the 5. workday	,d5	Readable/Writeable	24:00(hr:ı
0034d	0x0022	word	Defrost start time of the 6. workday	,d6	Readable/Writeable	24:00(hr:ı
0035d	0x0023	word	Defrost start time of the 1. holiday	F4	Readable/Writeable	24:00(hr:ı
0036d	0x0024	word	Defrost start time of the 2. holiday	F95	Readable/Writeable	24:00(hr:ı
0037d	0x0025	word	Defrost start time of the 3.holiday	Ed3	Readable/Writeable	24:00(hr:ı
0038d	0x0026	word	Defrost start time of the 4. holiday	E d 4	Readable/Writeable	24:00(hr:ı
0039d	0x0027	word	Defrost start time of the 5. holiday	£ d 5	Readable/Writeable	24:00(hr:r
0040d	0x0028	word	Defrost start time of the 6.holiday	E d 6	Readable/Writeable	24:00(hr:ı
0041d	0x0029	word	Energy-saving value of the difference set	Add	Readable/Writeable	0
0041d	0x0029	word	Energy-saving value of the unreferce set		Readable/Writeable	24:00(hr:i
				ıEŁ		
0043d 0044d	0x002B 0x002C	word	Workday energy-saving time Energy-saving start time of the holiday	,E5 EEE	Readable/Writeable Readable/Writeable	00:00 24:00(hr:i
0044U	0,0020	word	Energy daving dark anto of the floliday	LCC	Treatable/ Willeable	27.00(111.1

S	0046d	0x002E	word	Start time of Lighting on workdays	ı. 15E	Readable/Writeable	24:00(hr:min)
EN EN	0047d	0x002F	word	End time of Lighting on workdays	ı. IF d	Readable/Writeable	00:00
	0048d	0x0030	word	Start time of Lighting on holidays	E. 15E	Readable/Writeable	24:00(hr:min)
Σ	0049d	0x0031	word	End time of Lighting on holidays	E. IF d	Readable/Writeable	00:00
RTC PAR	(So,"14.		meter va	or of type integer,those "signed integer" is defined as the decima alue of "140" will be read in.)Relevant parameters for a period or nutes.			

^{*} Holding Register parameter of type integer, those "signed integer" is defined as the decimal port of and associated with these parameters. (So,"14.0" is a parameter value of "140" will be read in.)Relevant parameters for a period of "mm:ss"type ones in seconds,"hh:mm"while those species defined in minutes.

1.2 INPUT REGISTERS

•	Register dresses	Data	Data Content	Parameter	Read/Write
Decimal	Hex	ses Type		Name	Permission
0000d	0x0000	word	Measured temperature value (°C / °F)		Only readable

^{*} Input Register parameter value of the temperature reading, is defined as a signed integer. This value is associated with a portion.(So,"23,5°C"value of temperature "235" will be read in.)

1.3 DISCRETE INPUTS

	Discrete Input Addresses Data Type		Data Content	Parameter	Read/Write	
Decimal	nal Hex			Name	Permission	
0000d	0x00	Bit	Control output situation (compressor relay) (0=OFF; 1=ON)		Only readable	
0001d	0x01	Bit	Control output situation (defrost/lighting relay) (0=OFF; 1=ON)		Only readable	

1.4 COILS

-	coil dresses	Data	Data Content	Parameter Name	Read/Write	Status Value
Decimal	Hex	Туре		Name	Permission	value
00d	0x00	Bit	Control type selection. OFF=Cooling control ($\mathcal{E} \sigma$) ON=Heating control($\mathcal{H} \mathcal{E}$)	C.E YP	Readable/Writeable	C٥
01d	0x01	Bit	Control type selection. OFF=Cooling control ($\mathcal{L}_{\mathcal{D}}$) ON=Heating control($\mathcal{H}_{\mathcal{E}}$)	C.E YP	Readable/Writeable	Co
02d	0x02	Bit	Temperature unit. OFF=°C ON=°F	Un ıŁ	Readable/Writeable	٥٢
03d	0x03	Bit	Decimal point . OFF=n a ON=4E5	d.PnE	Readable/Writeable	no
04d	0x04	Bit	During defrost, display configuration. OFF=The temperature which is measured before defrost is displayed.(<i>L c</i>) ON=Real temperature is displayed during defrost process. (<i>r E</i>)	d.d5P	Readable/Writeable	Lc
05d	0x05	Bit	Defrosting process begins with energy.OFF=Defrost process doesn't start when,the energy comes.(na) ON=Defrost process starts when the energy comes. (485)	d.Pon	Readable/Writeable	no
06d	0x06	Bit	Alarm configuration .OFF=Absolute alarm ($\beta b b$) ON=Relative alarm ($r E F$)	A.E. Y.P	Readable/Writeable	AP2
07d	0x07	Bit	Digital input polarity.OFF=While a digital input contact is closed, it is activated.(cL) ON=While a digital input is opened, it is activated(cP)	dPo	Readable/Writeable	cL
08d	0x08	Bit	Defrost type selection OFF=Electrical defrost(ELE) ON=Hot gas defrost ($EB5$)	d.E	Readable/Writeable	ELC
09d	0x09	Bit	Defrost type (OFF=The normal operation of the defrost.(npr) ON=Defrost operation with RTC (r \(\chi_c \))	d.r.t.c	Readable/Writeable	nor
010d	0x0A	Bit	Control situation. OFF=Control passive.($\mathcal{L}.d \cdot \mathcal{L}$) ON=Control active($\mathcal{L}.\mathcal{E} \cap \mathcal{L}$)		Readable/Writeable	on

^{*}Control situation(coil-10) is read from coil-9 address, because d.r L c (coil-9) parameter is absent in devices without RTC.